

D-Valves Ltd.

6133 97 St
Edmonton, Alberta T6E 0J3
Phone (403) 436-5353 Fax (403) 436-7653

We certify that all inside blow-out preventers, Kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with:

- American Petroleum Institute (A.P.I.)
 - National Association of Corrosion Engineers (NACE) MR-01-75 specifications
 - Alberta Recommended Practices (A.R.P.)
- All valves have been pressure tested and charted.

Customer: Viper Reman's & Services
Work Order # 62203
Serial # D15500-430

Date: February 7, 2008
Size: 3 1/2" Eur D Valve Safety THOP, Nace, 2" pc
Pressure: 5,000 PSI

VRS-1900

Part Number	Material	Part Number	Material
Body & Sub	D15500	4140	17-4 PH
Stem	D1500S	Moore	17-4 PH
Upper Seat	D1500S	Moore	17-4 PH
Lower Seat	D1500S	Moore	17-4 PH
Spring Ring	D1500S	Moore	17-4 PH


Authorized Signature





— since 1988 —

Caliber Energy Systems
3 1/2" EUE D-Valve Safety IBOP
WO # 91662
VRS-1900

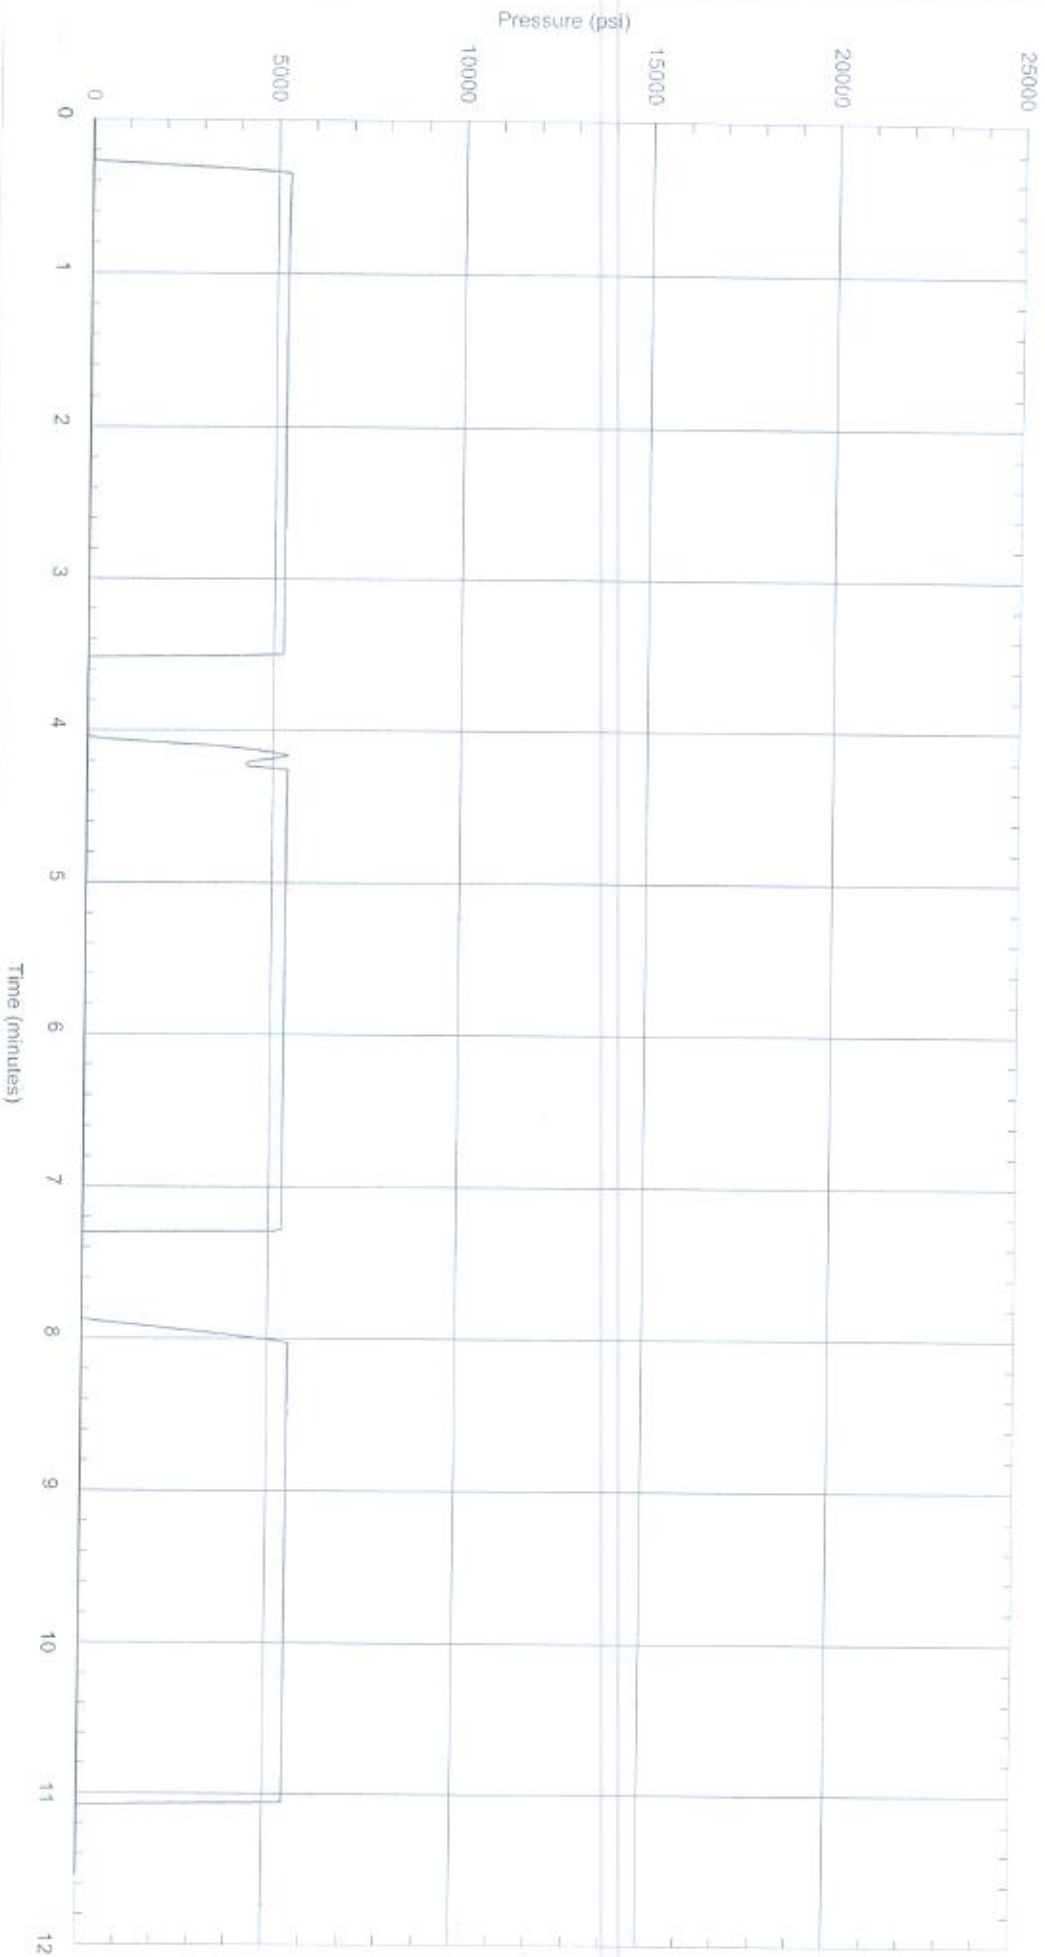

Date: November 18, 2016 04:15:58 PM
Recorded By: Mark Cummings