

D-Valves Ltd.

6133 -97 Street
Edmonton, Alberta T6E 3J3
Phone (780) 436-5353 Fax (780) 438-7906

We certify that all inside blow-out preventers, kellycocks and valves supplied on the work order listed below, are manufactured to meet all requirements in accordance with :

American Petroleum Institute (A.P.I.)
National Association of Corrosion Engineers (NACE) MR-01-75 specifications
Alberta Recommended Practices (A.R.P.)

All valves have been pressure tested and charted.

V/S 2036


Customer: Viper Rentals & Services
Work Order # 78022
Serial # D2875T-1325
Date: December 13, 2011
Size: 2 7/8 Euc D-Valve Safety, IBOP, NACE, 2 pcc.
Pressure: 5,000 PSI

Part	Number	Material	Part	Number	Material
Body & Sub	D2875T	4140	Ball	D2875-B	17-4 PH
Stem	D2875-S	Monel	Stem Bushing	D2875-SB	17-4 PH
Lower Seat	D2875-LS	Bronze	Upper Seat	D2875T-US	Bronze
Stop Ring	D2875-SR	17-4	Spring	DVA 1189	750X Inconel

Authorized Signature:

M. Lawrence

Caliber Energy Systems
2 7/8 Eue D-Valve Safety IBOP, Nace , 5000 PSI

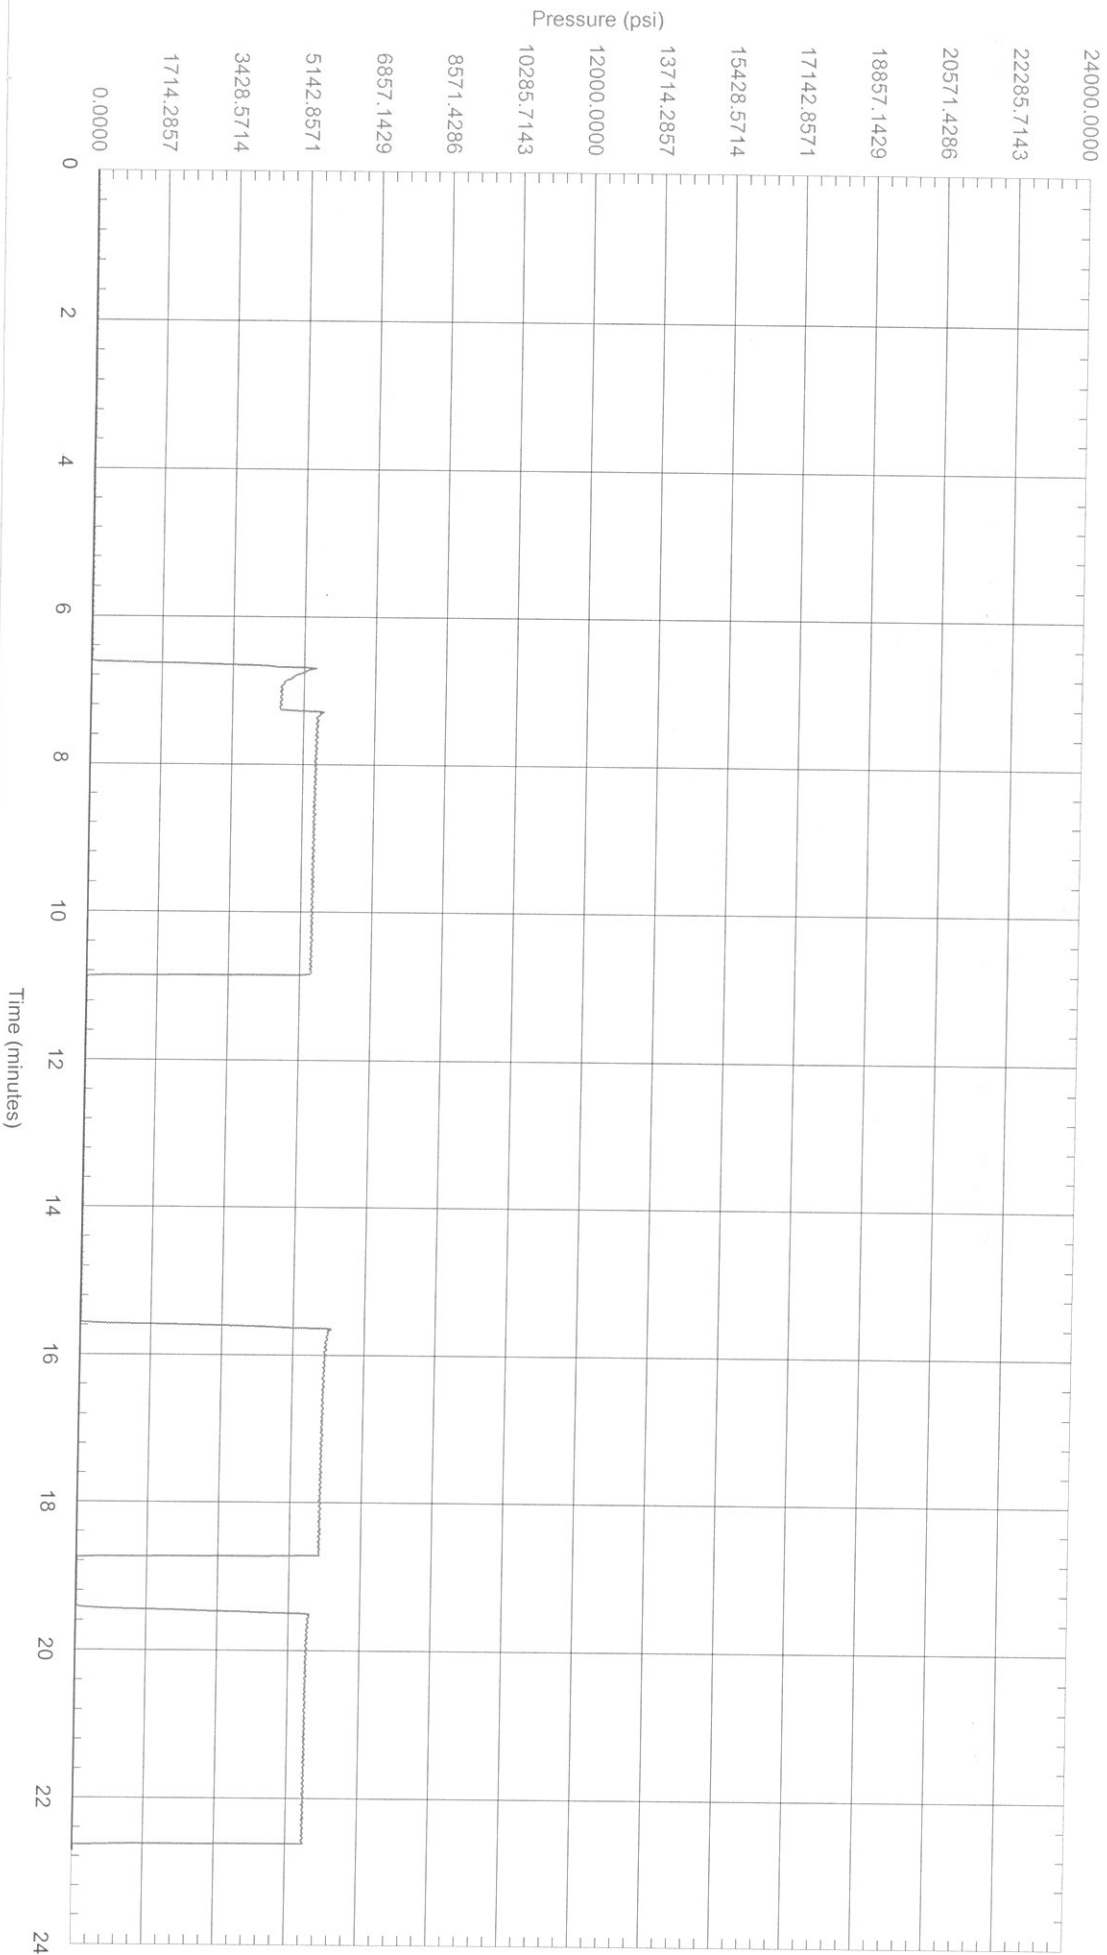

Date: February 29, 2016 10:25:11 AM
W/O 90668
S/N VRS-2036
Test Unit:
Tested By: Travis